


DASHED LINES INDICATE FIELD WIRING WHICH MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE USING A MINIMUM OF 10 AWG WIRE

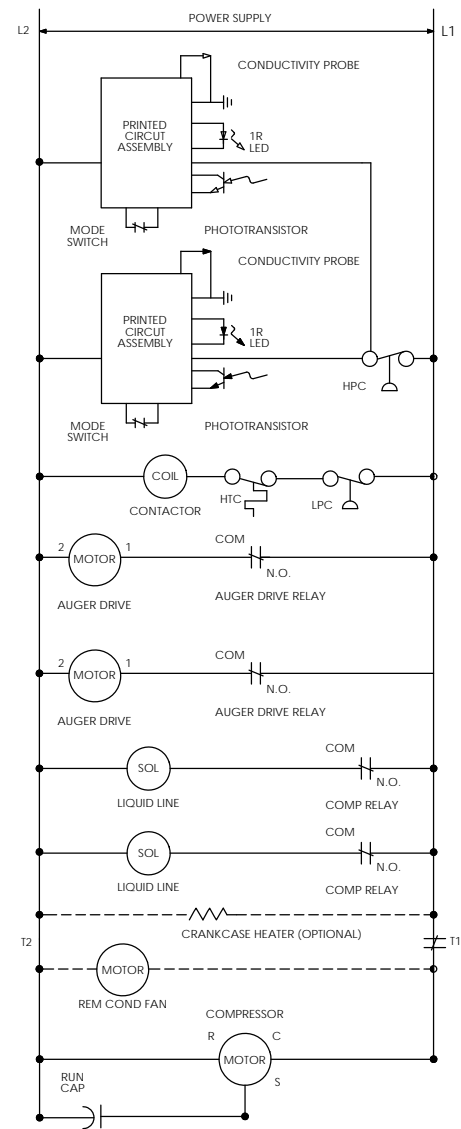

ALL CONTROLS SHOWN IN ICE MAKING MODE