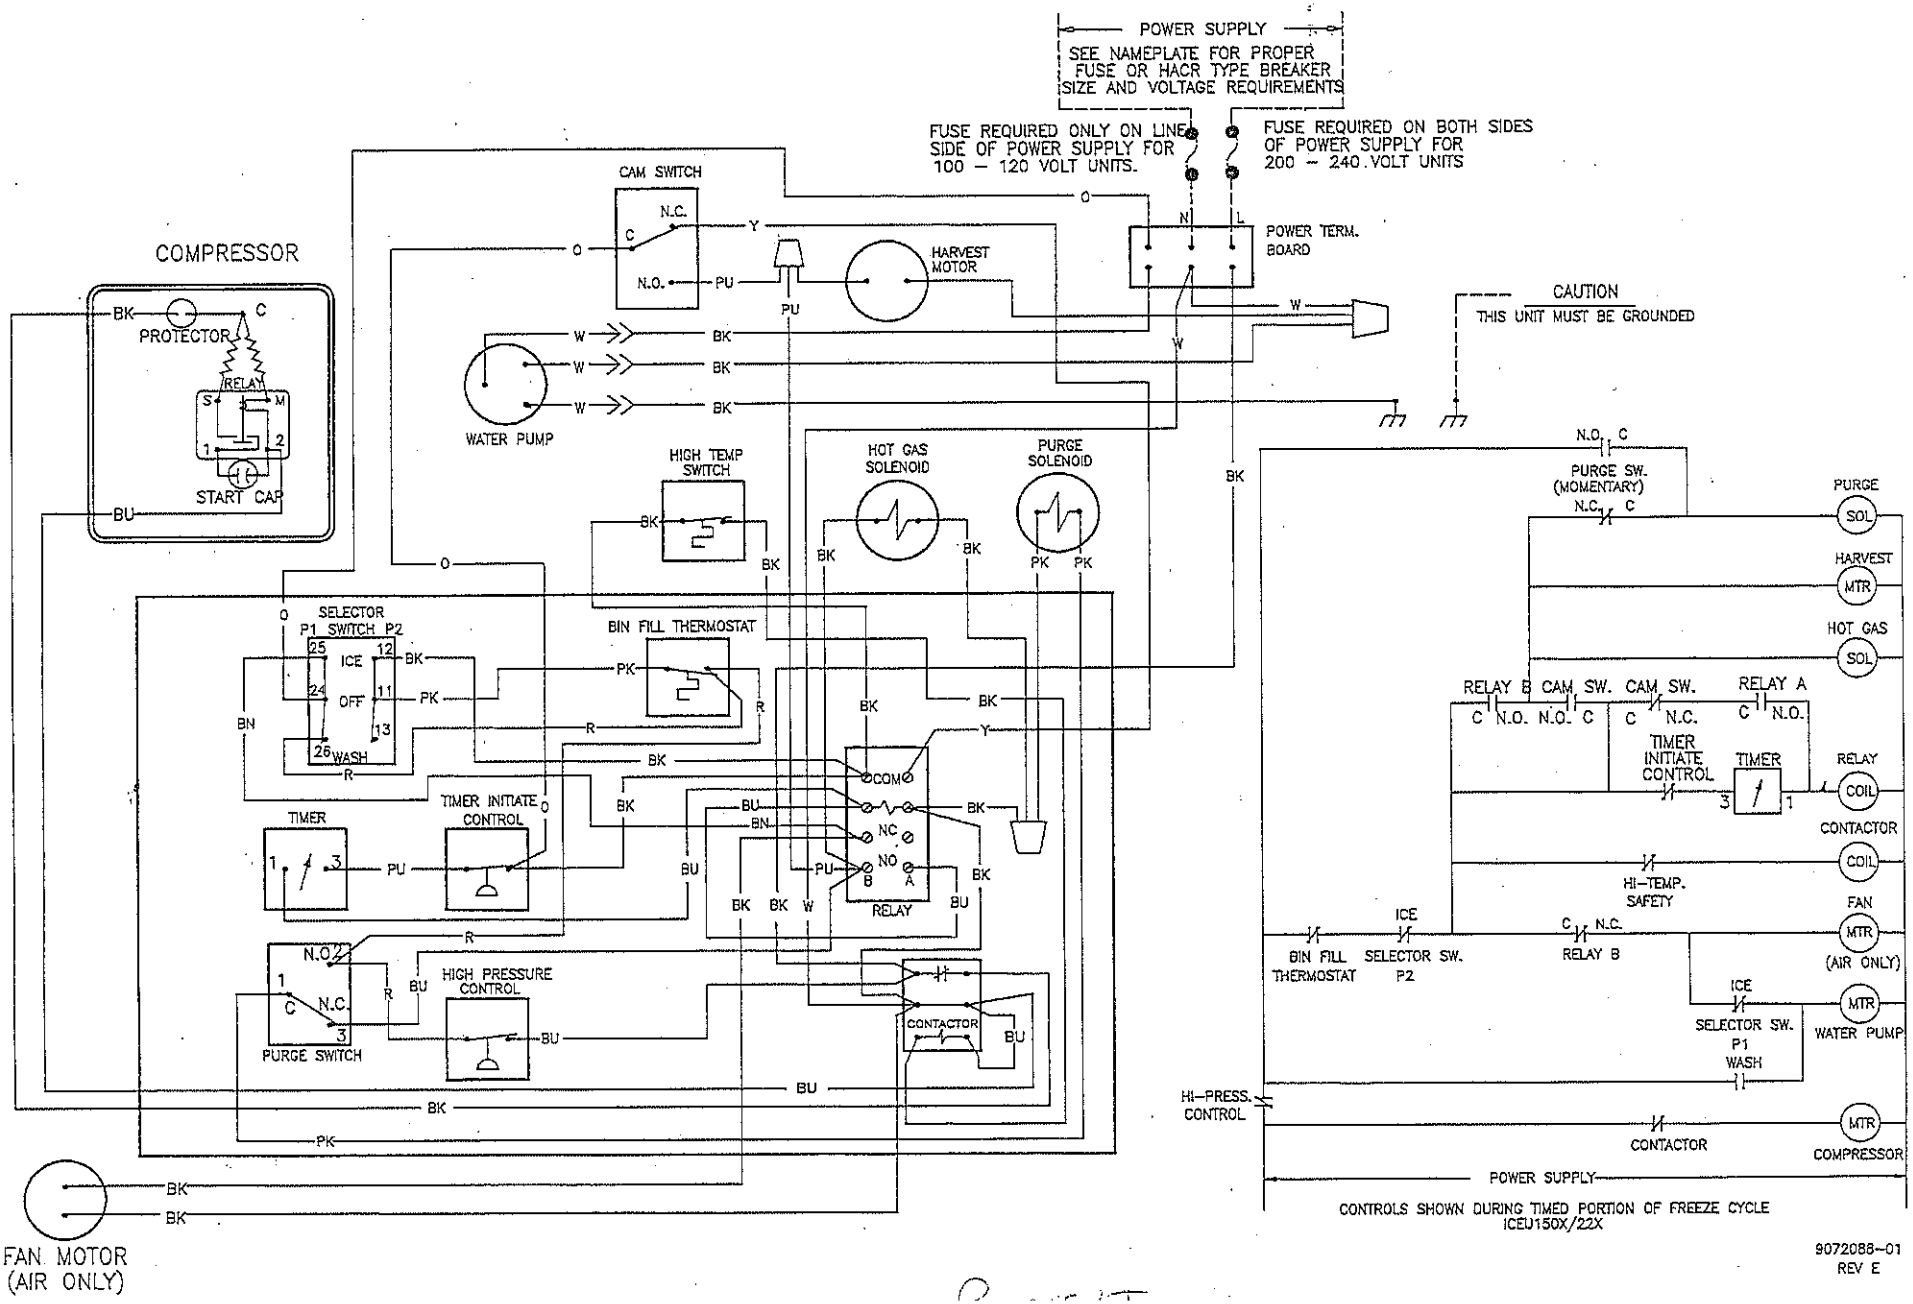
POWER SUPPLY
SEE NAMEPLATE FOR PROPER FUSE OR HACR TYPE BREAKER SIZE AND VOLTAGE REQUIREMENTS
FUSE REQUIRED ONLY ON LINE SIDE OF POWER SUPPLY FOR 100 – 120 VOLT UNITS.
FUSE REQUIRED ON BOTH SIDES OF POWER SUPPLY FOR 200 – 240 VOLT UNITS
CAUTION
THIS UNIT MUST BE GROUNDED
COMPRESSOR
PROTECTOR
RELAY
START CAP
CAM SWITCH
HARVEST MOTOR
POWER TERM. BOARD
WATER PUMP
HIGH TEMP SWITCH
HOT GAS SOLENOID
PURGE SOLENOID
SELECTOR SWITCH P1 P2
ICE
OFF
WASH
BIN FILL THERMOSTAT
TIMER
TIMER INITIATE CONTROL
RELAY
CONTACTOR
HIGH PRESSURE CONTROL
PURGE SWITCH
FAN MOTOR (AIR ONLY)
PURGE SW. (MOMENTARY)
RELAY B
CAM SW.
RELAY A
HI-TEMP. SAFETY
BIN FILL THERMOSTAT
SELECTOR SW. P2
SELECTOR SW. P1 WASH
HI-PRESS. CONTROL
COMPRESSOR
CONTROLS SHOWN DURING TIMED PORTION OF FREEZE CYCLE
ICEU150X/22X
9072088-01
REV E